


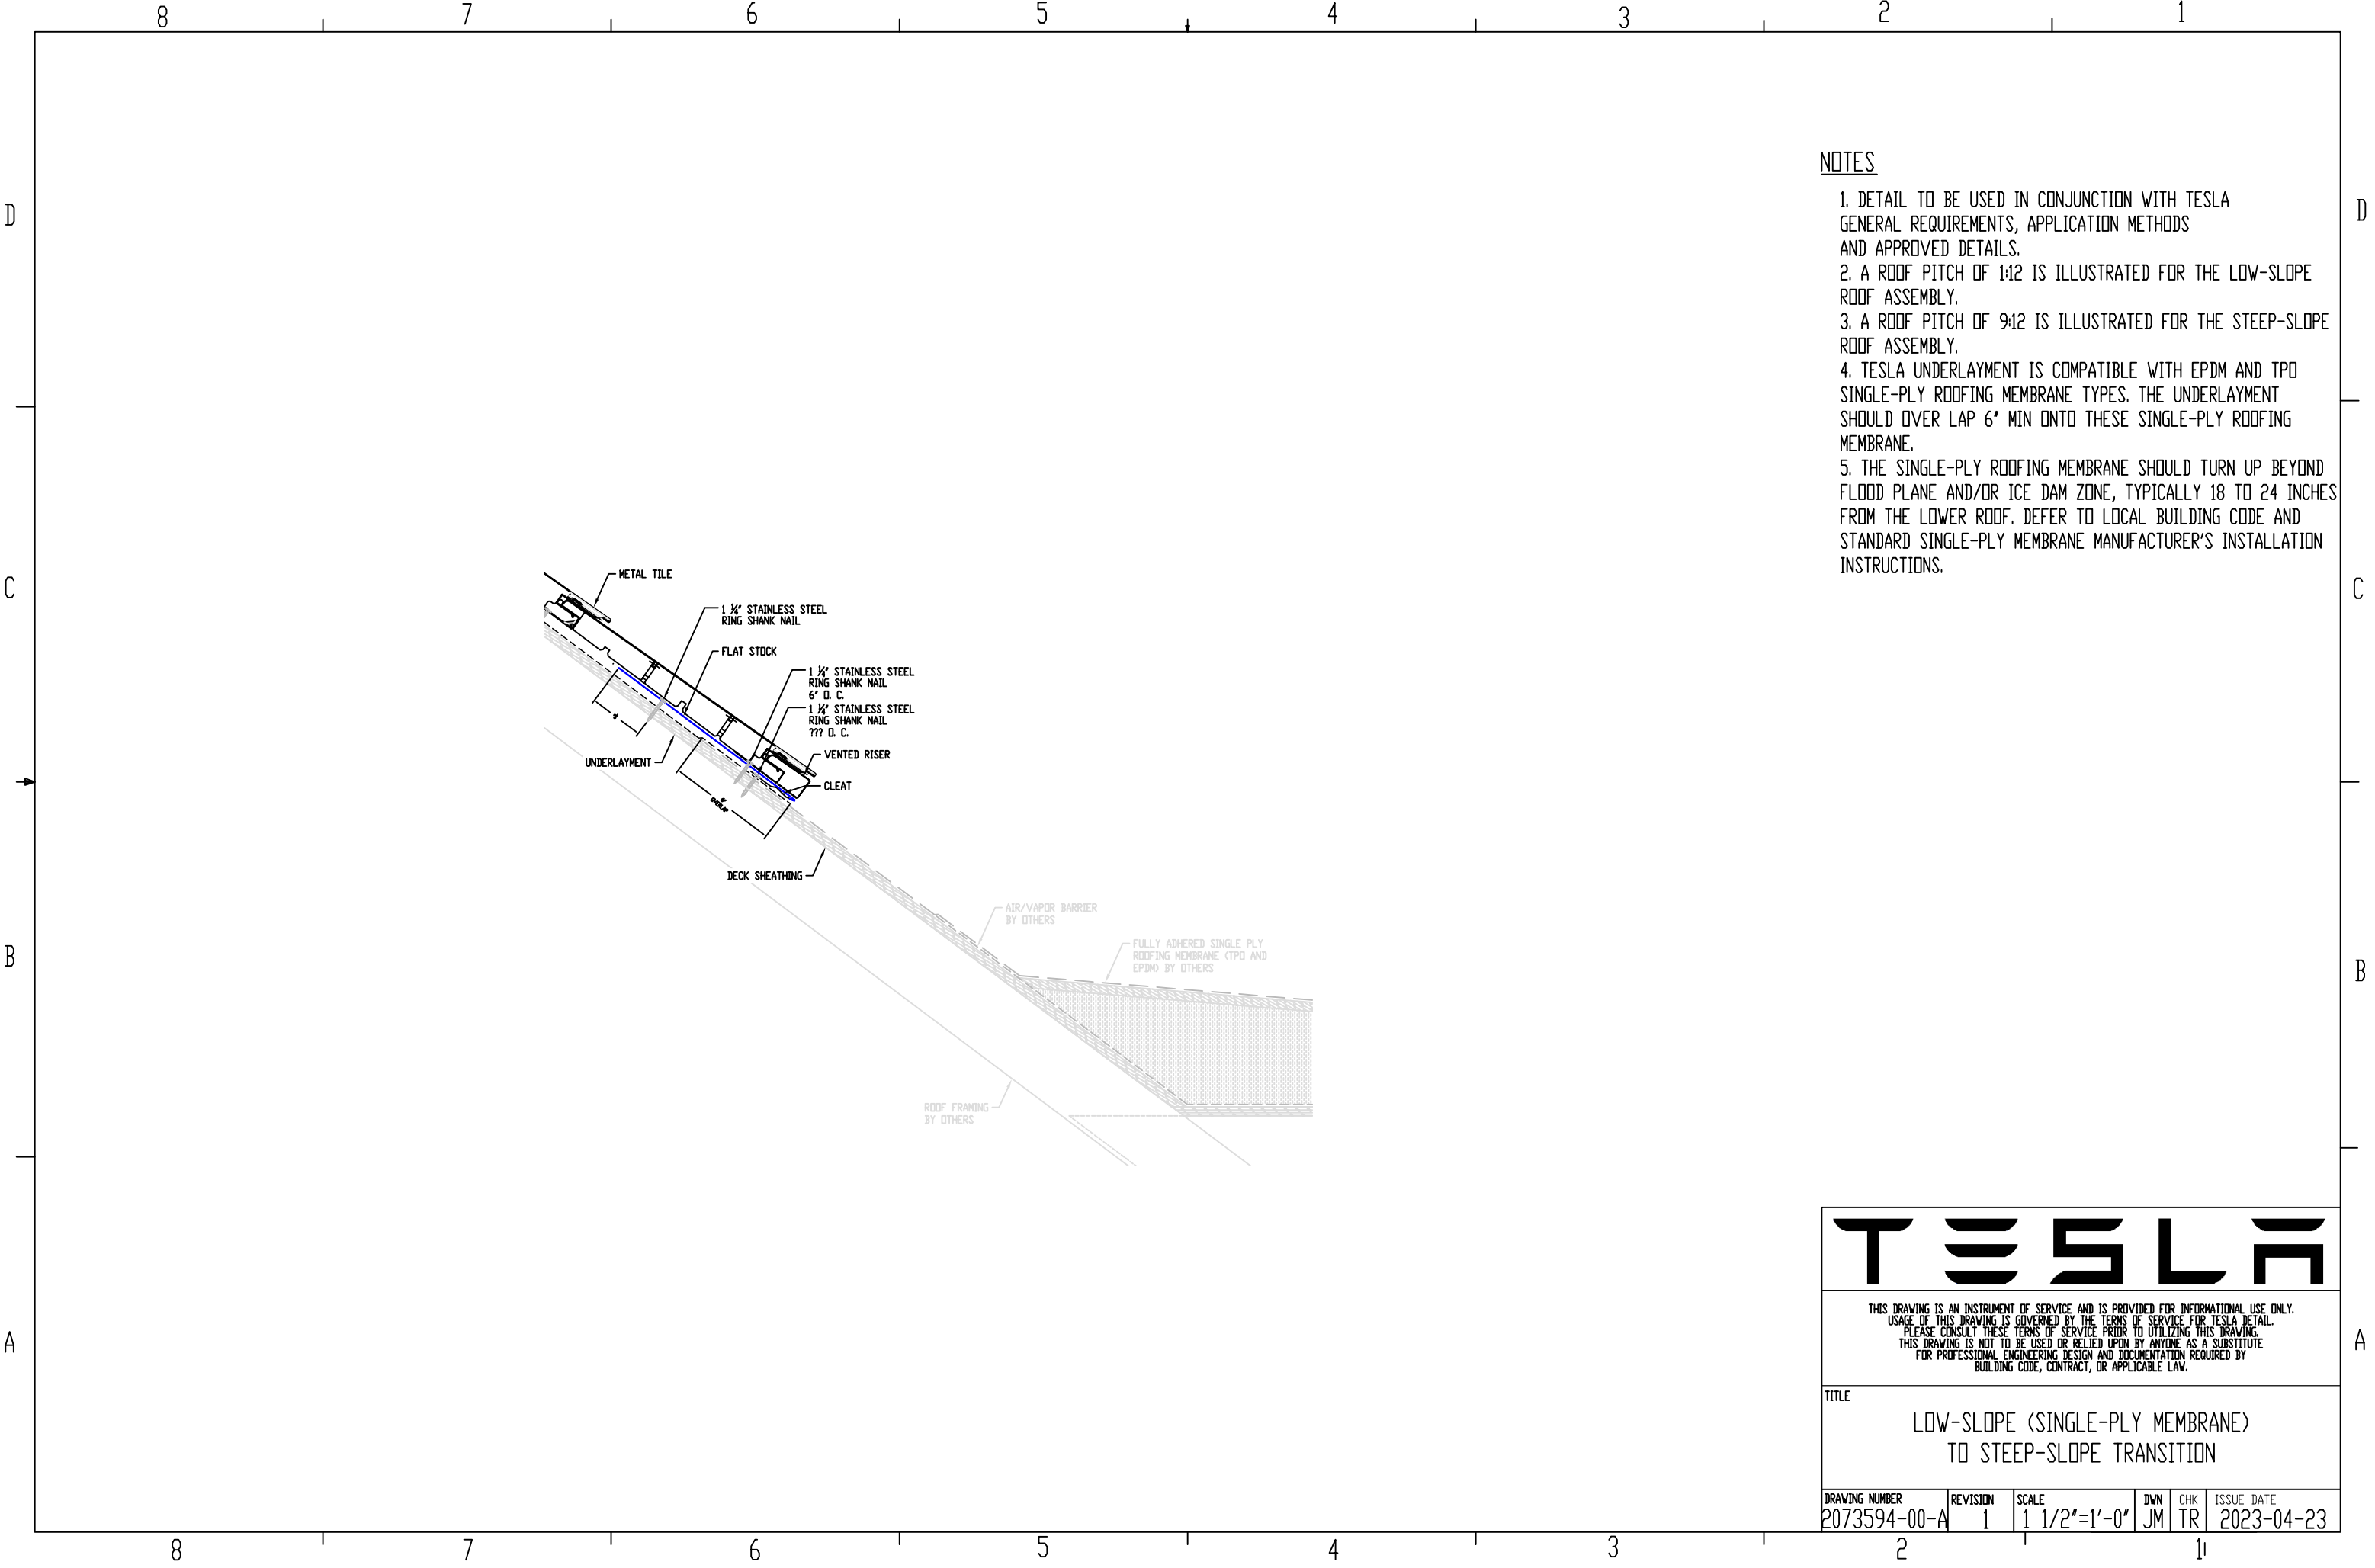

NOTES

1. DETAIL TO BE USED IN CONJUNCTION WITH TESLA GENERAL REQUIREMENTS, APPLICATION METHODS AND APPROVED DETAILS.
2. A ROOF PITCH OF 1:12 IS ILLUSTRATED FOR THE LOW-SLOPE ROOF ASSEMBLY.
3. A ROOF PITCH OF 9:12 IS ILLUSTRATED FOR THE STEEP-SLOPE ROOF ASSEMBLY.
4. TESLA UNDERLAYMENT IS COMPATIBLE WITH EPDM AND TPO SINGLE-PLY ROOFING MEMBRANE TYPES. THE UNDERLAYMENT SHOULD OVER LAP 6" MIN ONTO THESE SINGLE-PLY ROOFING MEMBRANE.
5. THE SINGLE-PLY ROOFING MEMBRANE SHOULD TURN UP BEYOND FLOOD PLANE AND/OR ICE DAM ZONE, TYPICALLY 18 TO 24 INCHES FROM THE LOWER ROOF. DEFER TO LOCAL BUILDING CODE AND STANDARD SINGLE-PLY MEMBRANE MANUFACTURER'S INSTALLATION INSTRUCTIONS.

TESLA

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND IS PROVIDED FOR INFORMATIONAL USE ONLY. USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR TESLA DETAIL. PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING. THIS DRAWING IS NOT TO BE USED OR RELIED UPON BY ANYONE AS A SUBSTITUTE FOR PROFESSIONAL ENGINEERING DESIGN AND DOCUMENTATION REQUIRED BY BUILDING CODE, CONTRACT, OR APPLICABLE LAW.

TITLE

LOW-SLOPE (SINGLE-PLY MEMBRANE)
TO STEEP-SLOPE TRANSITION

DRAWING NUMBER	REVISION	SCALE	DWN	CHK	ISSUE DATE
2073594-00-A	1	1 1/2"=1'-0"	JM	TR	2023-04-23