
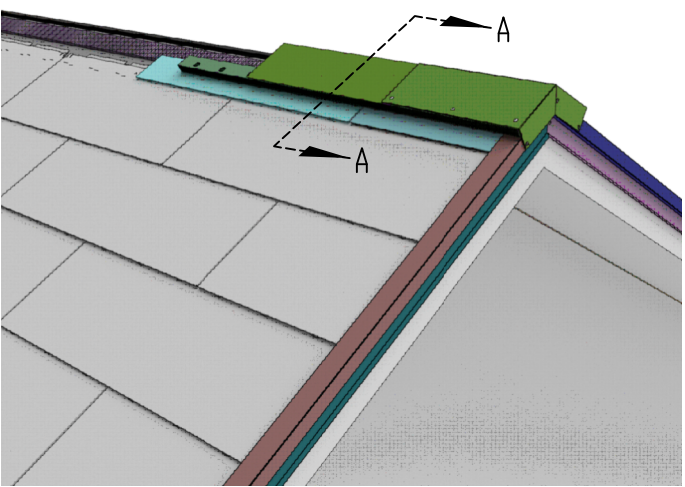


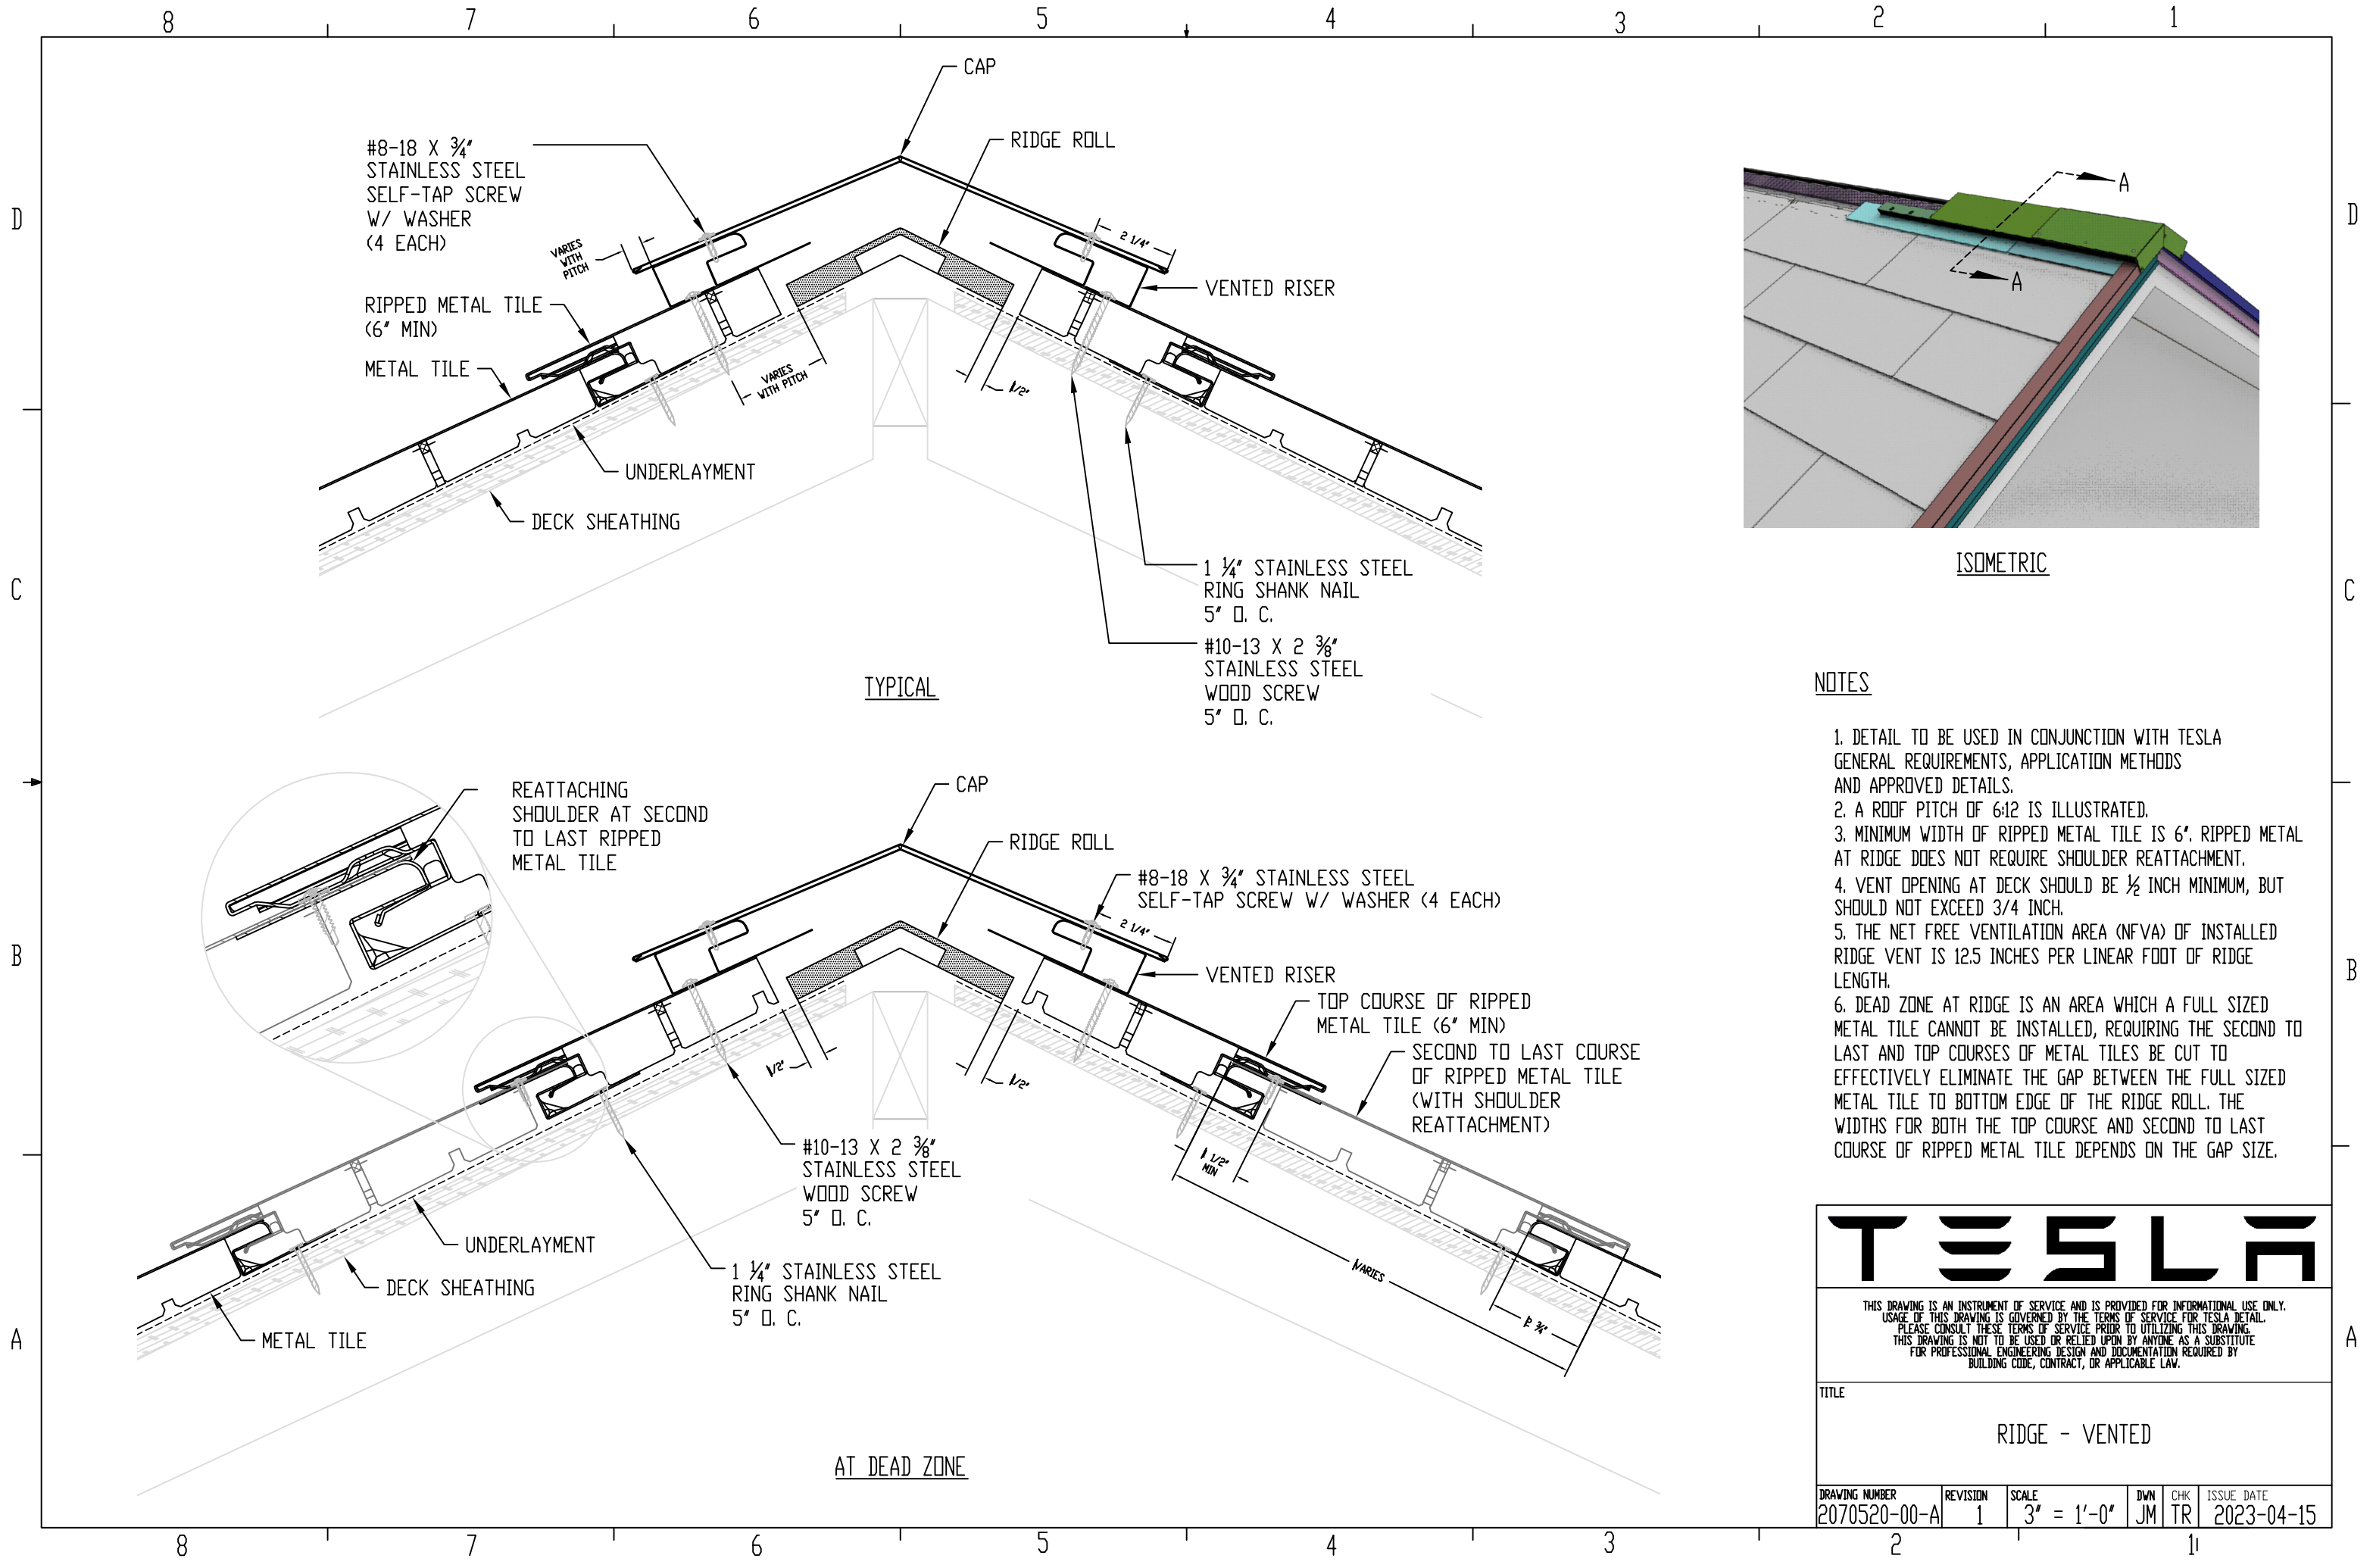

ISOMETRIC

NOTES

1. DETAIL TO BE USED IN CONJUNCTION WITH TESLA GENERAL REQUIREMENTS, APPLICATION METHODS AND APPROVED DETAILS.
2. A ROOF PITCH OF 6:12 IS ILLUSTRATED.
3. MINIMUM WIDTH OF RIPPED METAL TILE IS 6". RIPPED METAL AT RIDGE DOES NOT REQUIRE SHOULDER REATTACHMENT.
4. VENT OPENING AT DECK SHOULD BE 1/2 INCH MINIMUM, BUT SHOULD NOT EXCEED 3/4 INCH.
5. THE NET FREE VENTILATION AREA (NFVA) OF INSTALLED RIDGE VENT IS 12.5 INCHES PER LINEAR FOOT OF RIDGE LENGTH.
6. DEAD ZONE AT RIDGE IS AN AREA WHICH A FULL SIZED METAL TILE CANNOT BE INSTALLED, REQUIRING THE SECOND TO LAST AND TOP COURSES OF METAL TILES BE CUT TO EFFECTIVELY ELIMINATE THE GAP BETWEEN THE FULL SIZED METAL TILE TO BOTTOM EDGE OF THE RIDGE ROLL. THE WIDTHS FOR BOTH THE TOP COURSE AND SECOND TO LAST COURSE OF RIPPED METAL TILE DEPENDS ON THE GAP SIZE.

TESLA

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND IS PROVIDED FOR INFORMATIONAL USE ONLY. USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR TESLA DETAIL. PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING. THIS DRAWING IS NOT TO BE USED OR RELIED UPON BY ANYONE AS A SUBSTITUTE FOR PROFESSIONAL ENGINEERING DESIGN AND DOCUMENTATION REQUIRED BY BUILDING CODE, CONTRACT, OR APPLICABLE LAW.

TITLE

RIDGE - VENTED

DRAWING NUMBER	REVISION	SCALE	DWN	CHK	ISSUE DATE
2070520-00-A	1	3" = 1'-0"	JM	TR	2023-04-15