




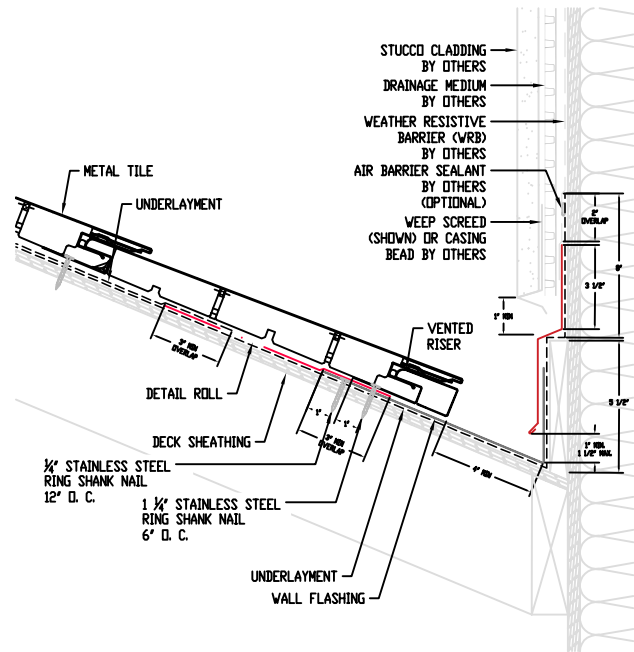

END WALL

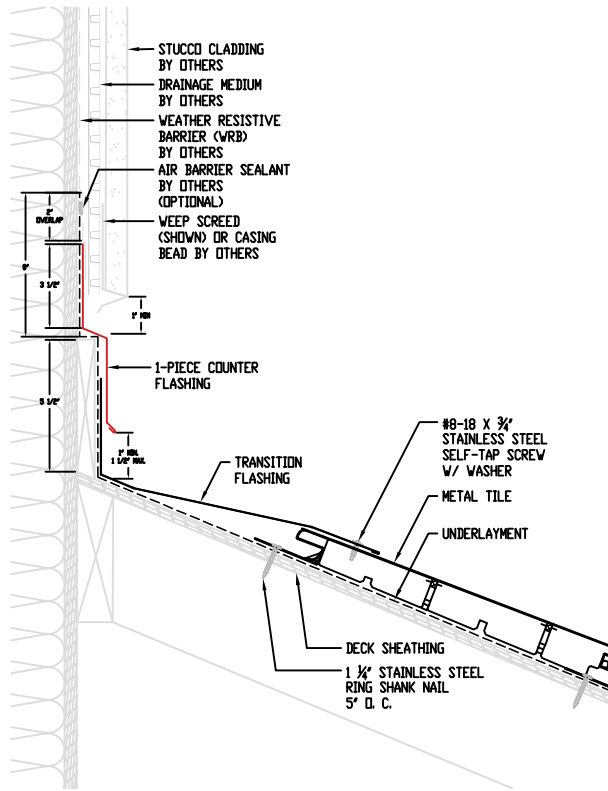

HEAD WALL

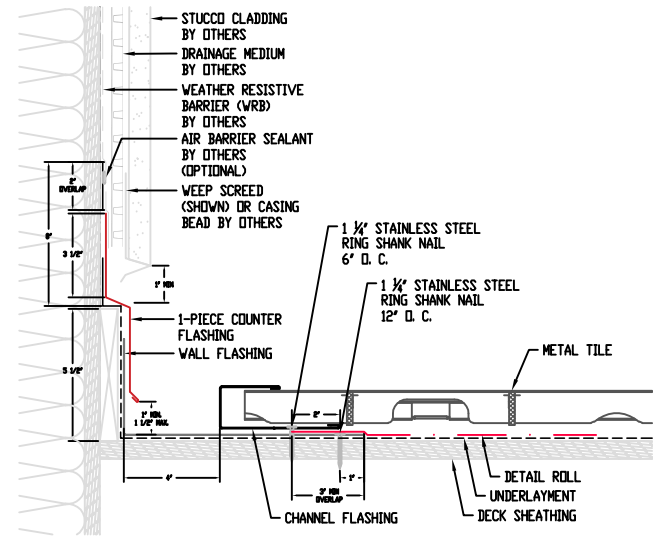


SIDE WALL

NOTES


1. DETAIL TO BE USED IN CONJUNCTION WITH TESLA GENERAL REQUIREMENTS, APPLICATION METHODS AND APPROVED DETAILS.
2. ROOF DECK SHOULD HAVE A MINIMUM OF 2% SLOPE TO MINIMIZE WATER PONDING.

RECOMMENDED INSTALLATION SEQUENCE FOR NEW CONSTRUCTION

1. INSTALL 1x6 BLOCKING.
2. INSTALL UNDERLAYMENT. EXTEND UNDERLAYMENT 8' MIN ABOVE BLOCKING SUCH THAT WALL WEATHER RESISTIVE BARRIER (WRB) POSITIVELY LAPS OVER UNDERLAYMENT UPTURN AND UPPER LEG OF 1-PIECE COUNTER FLASHING FOR 2-INCH MIN.
3. PRESERVE AIR BARRIER CONTINUITY BY INSTALLING APPROPRIATE SEALANT PER ARCHITECT OR BUILDING PROFESSIONALS.
4. INSTALL 1-PIECE COUNTER FLASHING.
5. INSTALL STUCCO CLADDING. PROVIDE A 1-INCH MINIMUM GAP BETWEEN STUCCO CLADDING AND 1-PIECE COUNTER FLASHING.
6. INSTALL DRY-IN METAL FLASHING. ENSURE POSITIVE LAP BETWEEN UPPER LEG OF DRY-IN METAL FLASHING. DISTANCE BETWEEN BOTTOM OF 1-PIECE COUNTER FLASHING AND DRY-IN METAL FLASHINGS SHOULD BE 1-INCH MIN AND 1 1/2-INCH MAX
7. PROCEED WITH SOLAR ROOF INSTALLATION.



RECOMMENDED: 1-PIECE COUNTER FLASHING
WITH HEMMED DRIP EDGE
PROFILE



OPTION: 1-PIECE COUNTER FLASHING
WITH STRAIGHT HEMMED EGDE
PROFILE

TESLA

THIS DRAWING IS AN INSTRUMENT OF SERVICE AND IS PROVIDED FOR INFORMATIONAL USE ONLY. USAGE OF THIS DRAWING IS GOVERNED BY THE TERMS OF SERVICE FOR TESLA DETAIL. PLEASE CONSULT THESE TERMS OF SERVICE PRIOR TO UTILIZING THIS DRAWING. THIS DRAWING IS NOT TO BE USED OR RELIED UPON BY ANYONE AS A SUBSTITUTE FOR PROFESSIONAL ENGINEERING DESIGN AND DOCUMENTATION REQUIRED BY BUILDING CODE, CONTRACT, OR APPLICABLE LAW.

TITLE HEAD, SIDE, END WALL AT RAINSCREEN STUCCO CLADDING USING THROUGH WALL COUNTERFLASHING				
DRAWING NUMBER	REVISION	SCALE	DWN	ISSUE DATE
2064801-01-A	0	1 1/2"=1'-0"	JM	2023-03-28